

[235]


24<u>1</u>"

[616]

[140]

MINIMUM DEPTH



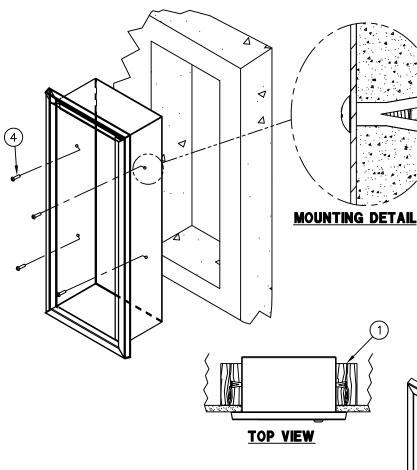

## **INSTALLATION INSTRUCTIONS:**

- A. PROVIDE  $9\frac{1}{4}$ " X  $24\frac{1}{4}$ " WALL OPENING AND BACKING (1) TO ACCEPT CABINET. MINIMUM  $5\frac{1}{2}$ " DEPTH FROM FINISHED WALL.
- B. DRILL HOUSING (2) TO LOCATE MOUNTING POINTS WHERE BACKING EXISTS. REMOVE HOUSING (2) AND INSTALL WALL ANCHORS (3) (BY OTHERS) REQUIRED FOR WALL/TYPE BACKING.
- C. INSTALL FIRE EXTINGUISHER HOUSING (2) INTO WALL OPENING (1).
- D. FASTEN HOUSING (2) INTO WALL USING SCREWS TO SUIT WALL CONSTRUCTION (BY OTHERS).

IMPORTANT! AFTER INSTALLATION. ALL JOINTS REQUIRE SECURITY SEALANT BY INSTALLER TO ELIMINATE GAPS BETWEEN WALL AND FIXTURE.

LOCATE ITEM TO CONFORM WITH APPLICABLE CODES FOR ACCESSIBILITY.



NOTE: WEIGHT WITHOUT FIRE EXTINGUISHER = 14 lbs.

**WALL OPENING** 

WHITEHALL MANUFACTURING P.O. BOX 3527 Industry, CA 91744 15125 Proctor Ave Industry, CA 91746 (626) 968-6681 FAX (626) 855-4862 LIGATURE RESISTANT RECESSED FIRE EXTINGUISHER CABINET WH1704-A MANUFACTURE DATE DRAWING NUMBER DATE ISSUED **AUGUST 2018** 10/12/2022 9918-135-001 DATE REVISED TO PRESENT